

**PENSACOLA FIRE STN #4  
1 N Q ST  
PENSACOLA, FL 32505**

**PFAS SAMPLE RESULTS  
TOTAL PFOA + PFOS**

- ★ >HAL
- ★ >1/2 HAL
- >1/4 HAL
- <1/4 HAL
- ▲ BDL
- ⊗ No Sample for this Analysis

**Wells PFAS Level**


- 1 >HAL
- 0 >1/2 HAL
- 0 >1/4 HAL
- 1 <1/4 HAL
- 1 Below Detection




**Florida  
Department of Health  
Bureau of  
Environmental Health**

Disclaimer

This product is for reference purposes only and is not to be construed as a legal document. Any reliance on the information contained herein is at the user's own risk. The Florida Department of Health and its agents assume no responsibility for any use of the information contained herein or any loss resulting therefrom.

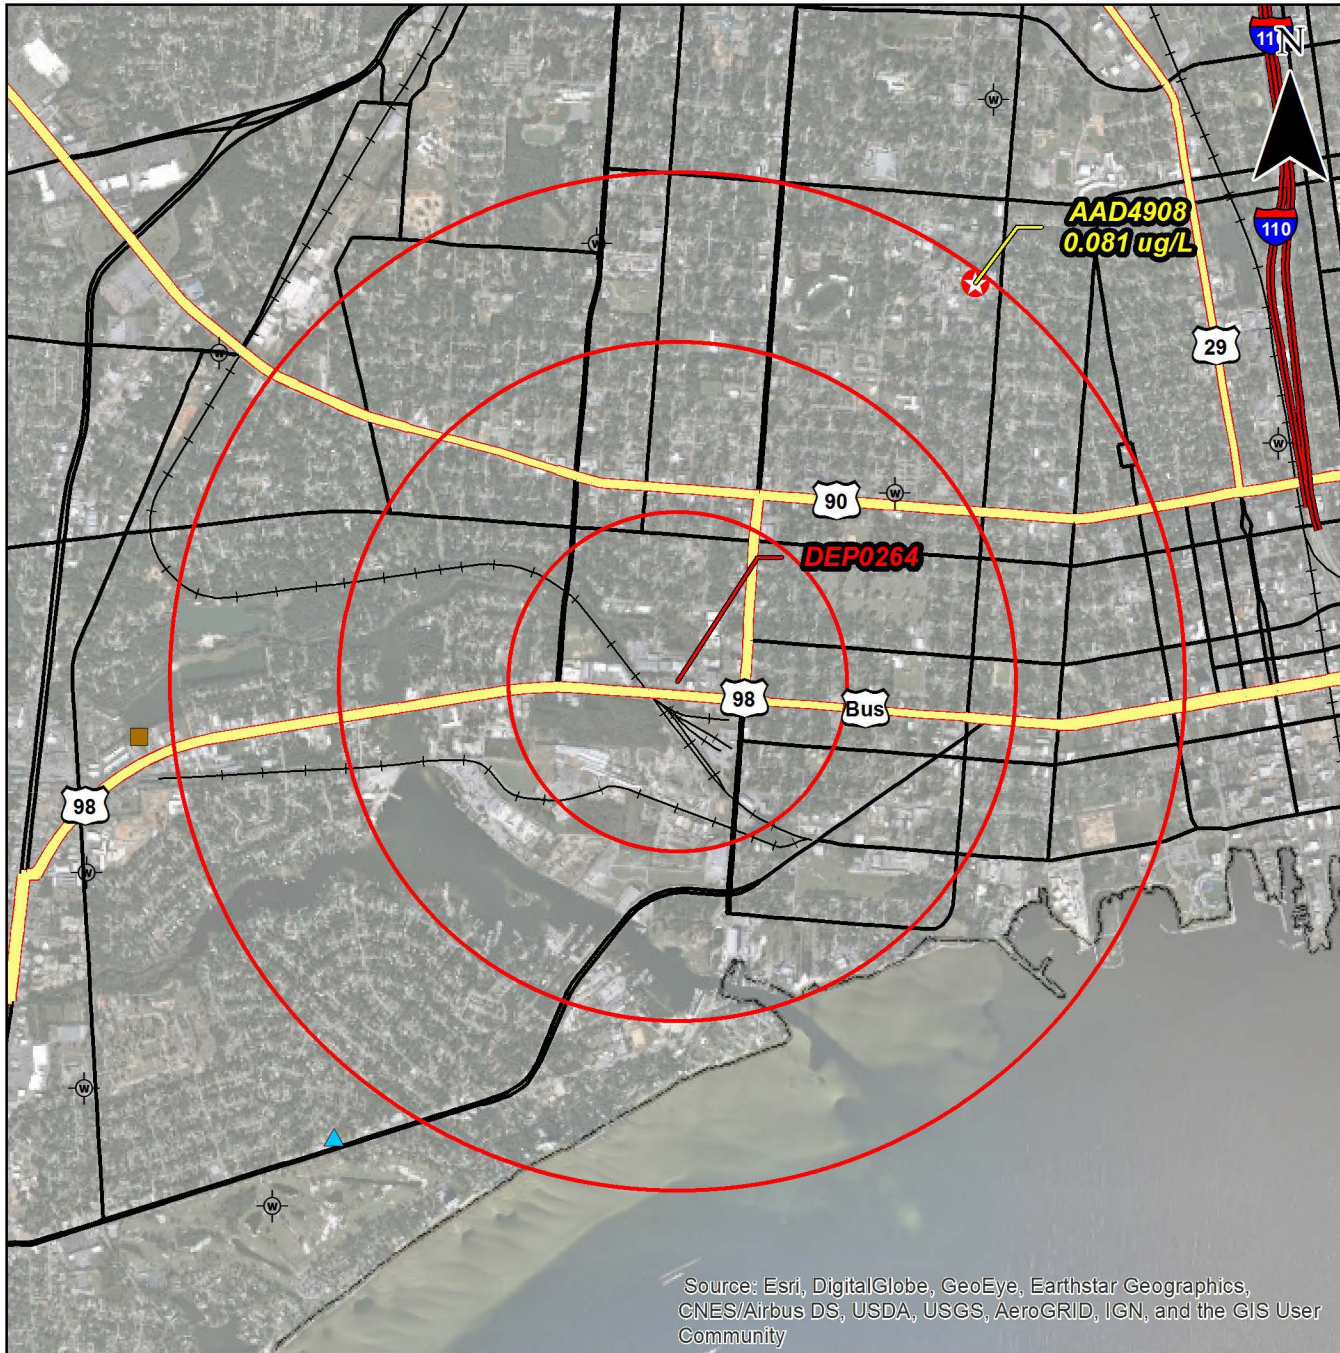

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community



Date: 12/5/2019