


ENGLEWOOD FIRE TRAINING FACILITY

13400 HALIGAN WAY

ENGLEWOOD, FL 34223

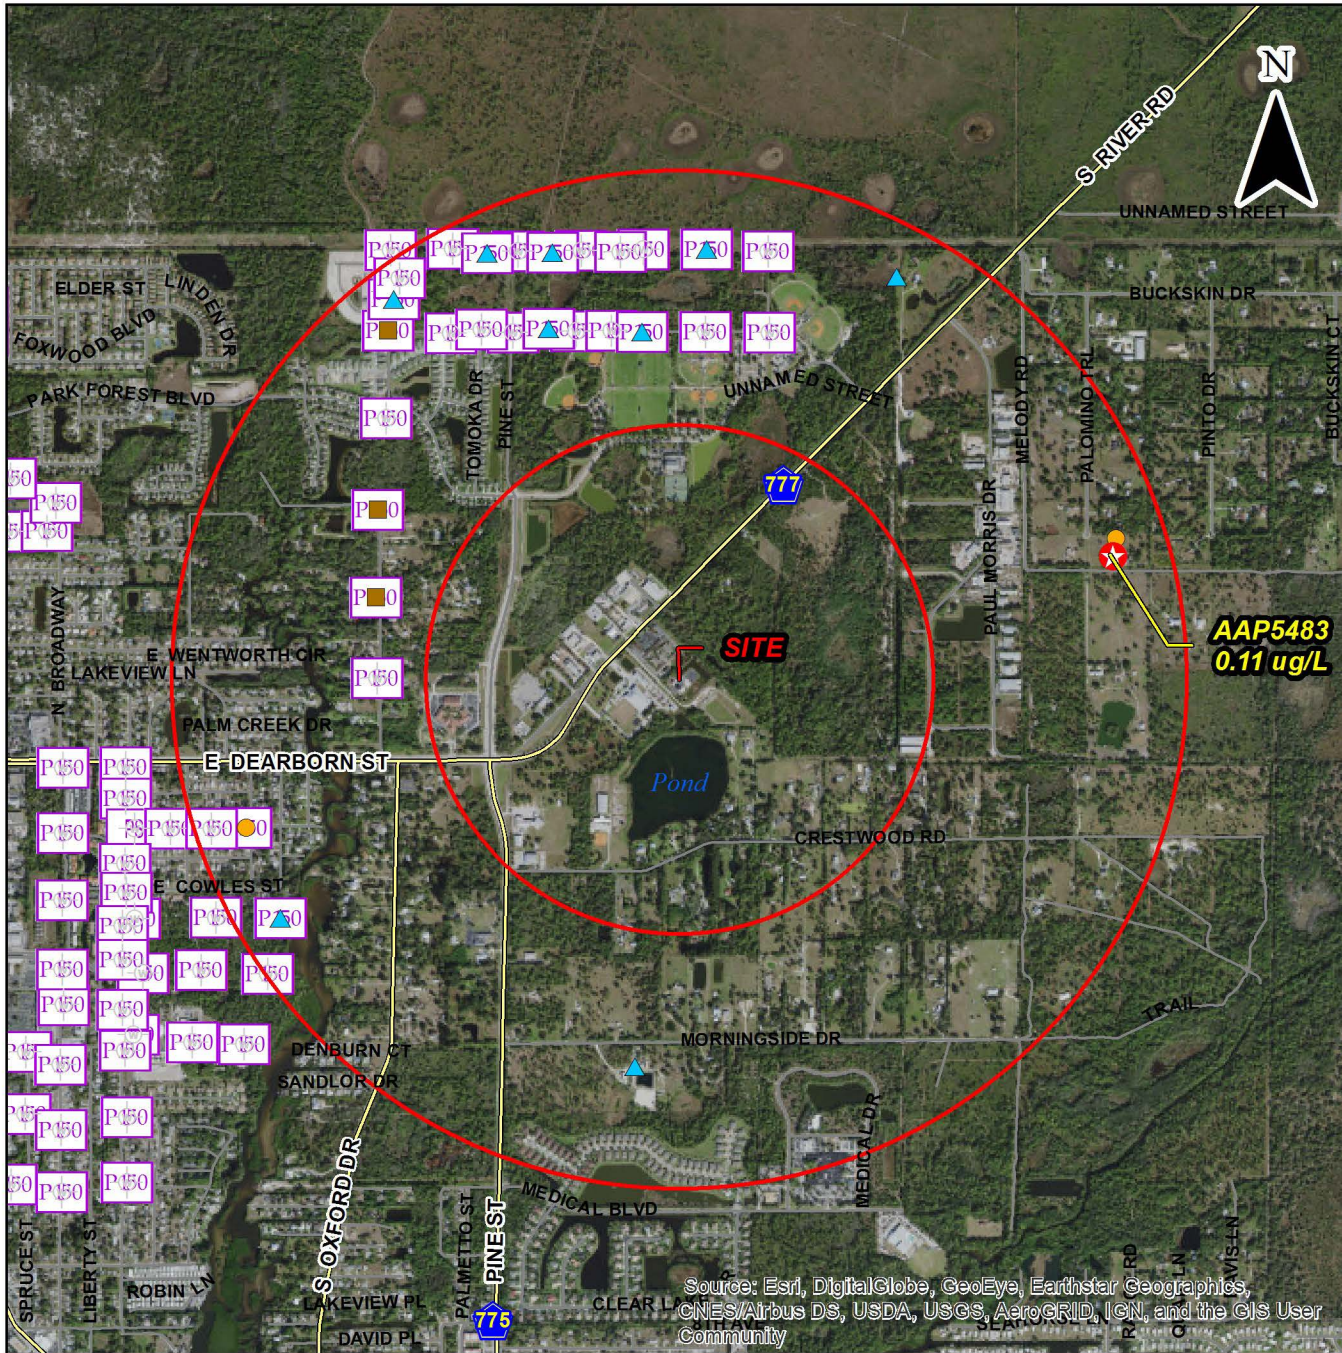

PFAS SAMPLE RESULTS

TOTAL PFOA + PFOS

- ★ >HAL
- ★ >1/2 HAL
- >1/4 HAL
- <1/4 HAL
- ▲ BDL
- ⊙ No Sample for this Analysis

Public Water Wells

System Capacity

- PS PWS < 150,000 gpd
- P150 PWS > 150,000 gpd
- P? Unspecified

Wells PFAS Level

- 1 >HAL
- 0 >1/2 HAL
- 2 >1/4 HAL
- 3 <1/4 HAL
- 9 Below Detection



Florida
Department of Health
Bureau of
Environmental Health

Source: Esri, DigitalGlobe, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community

Disclaimer
This product is for reference purposes only and is not to be construed as a legal document. Any reliance on the information contained herein is at the user's own risk. The Florida Department of Health and its agents assume no responsibility for any use of the information contained herein or any loss resulting therefrom.

Date: 10/9/2019