


N:\Projects-Other Offices\Miami\2019\H8197038\cad jan 2020\7038-water data 1.dwg  
 Jan 16, 2020 - 3:49pm

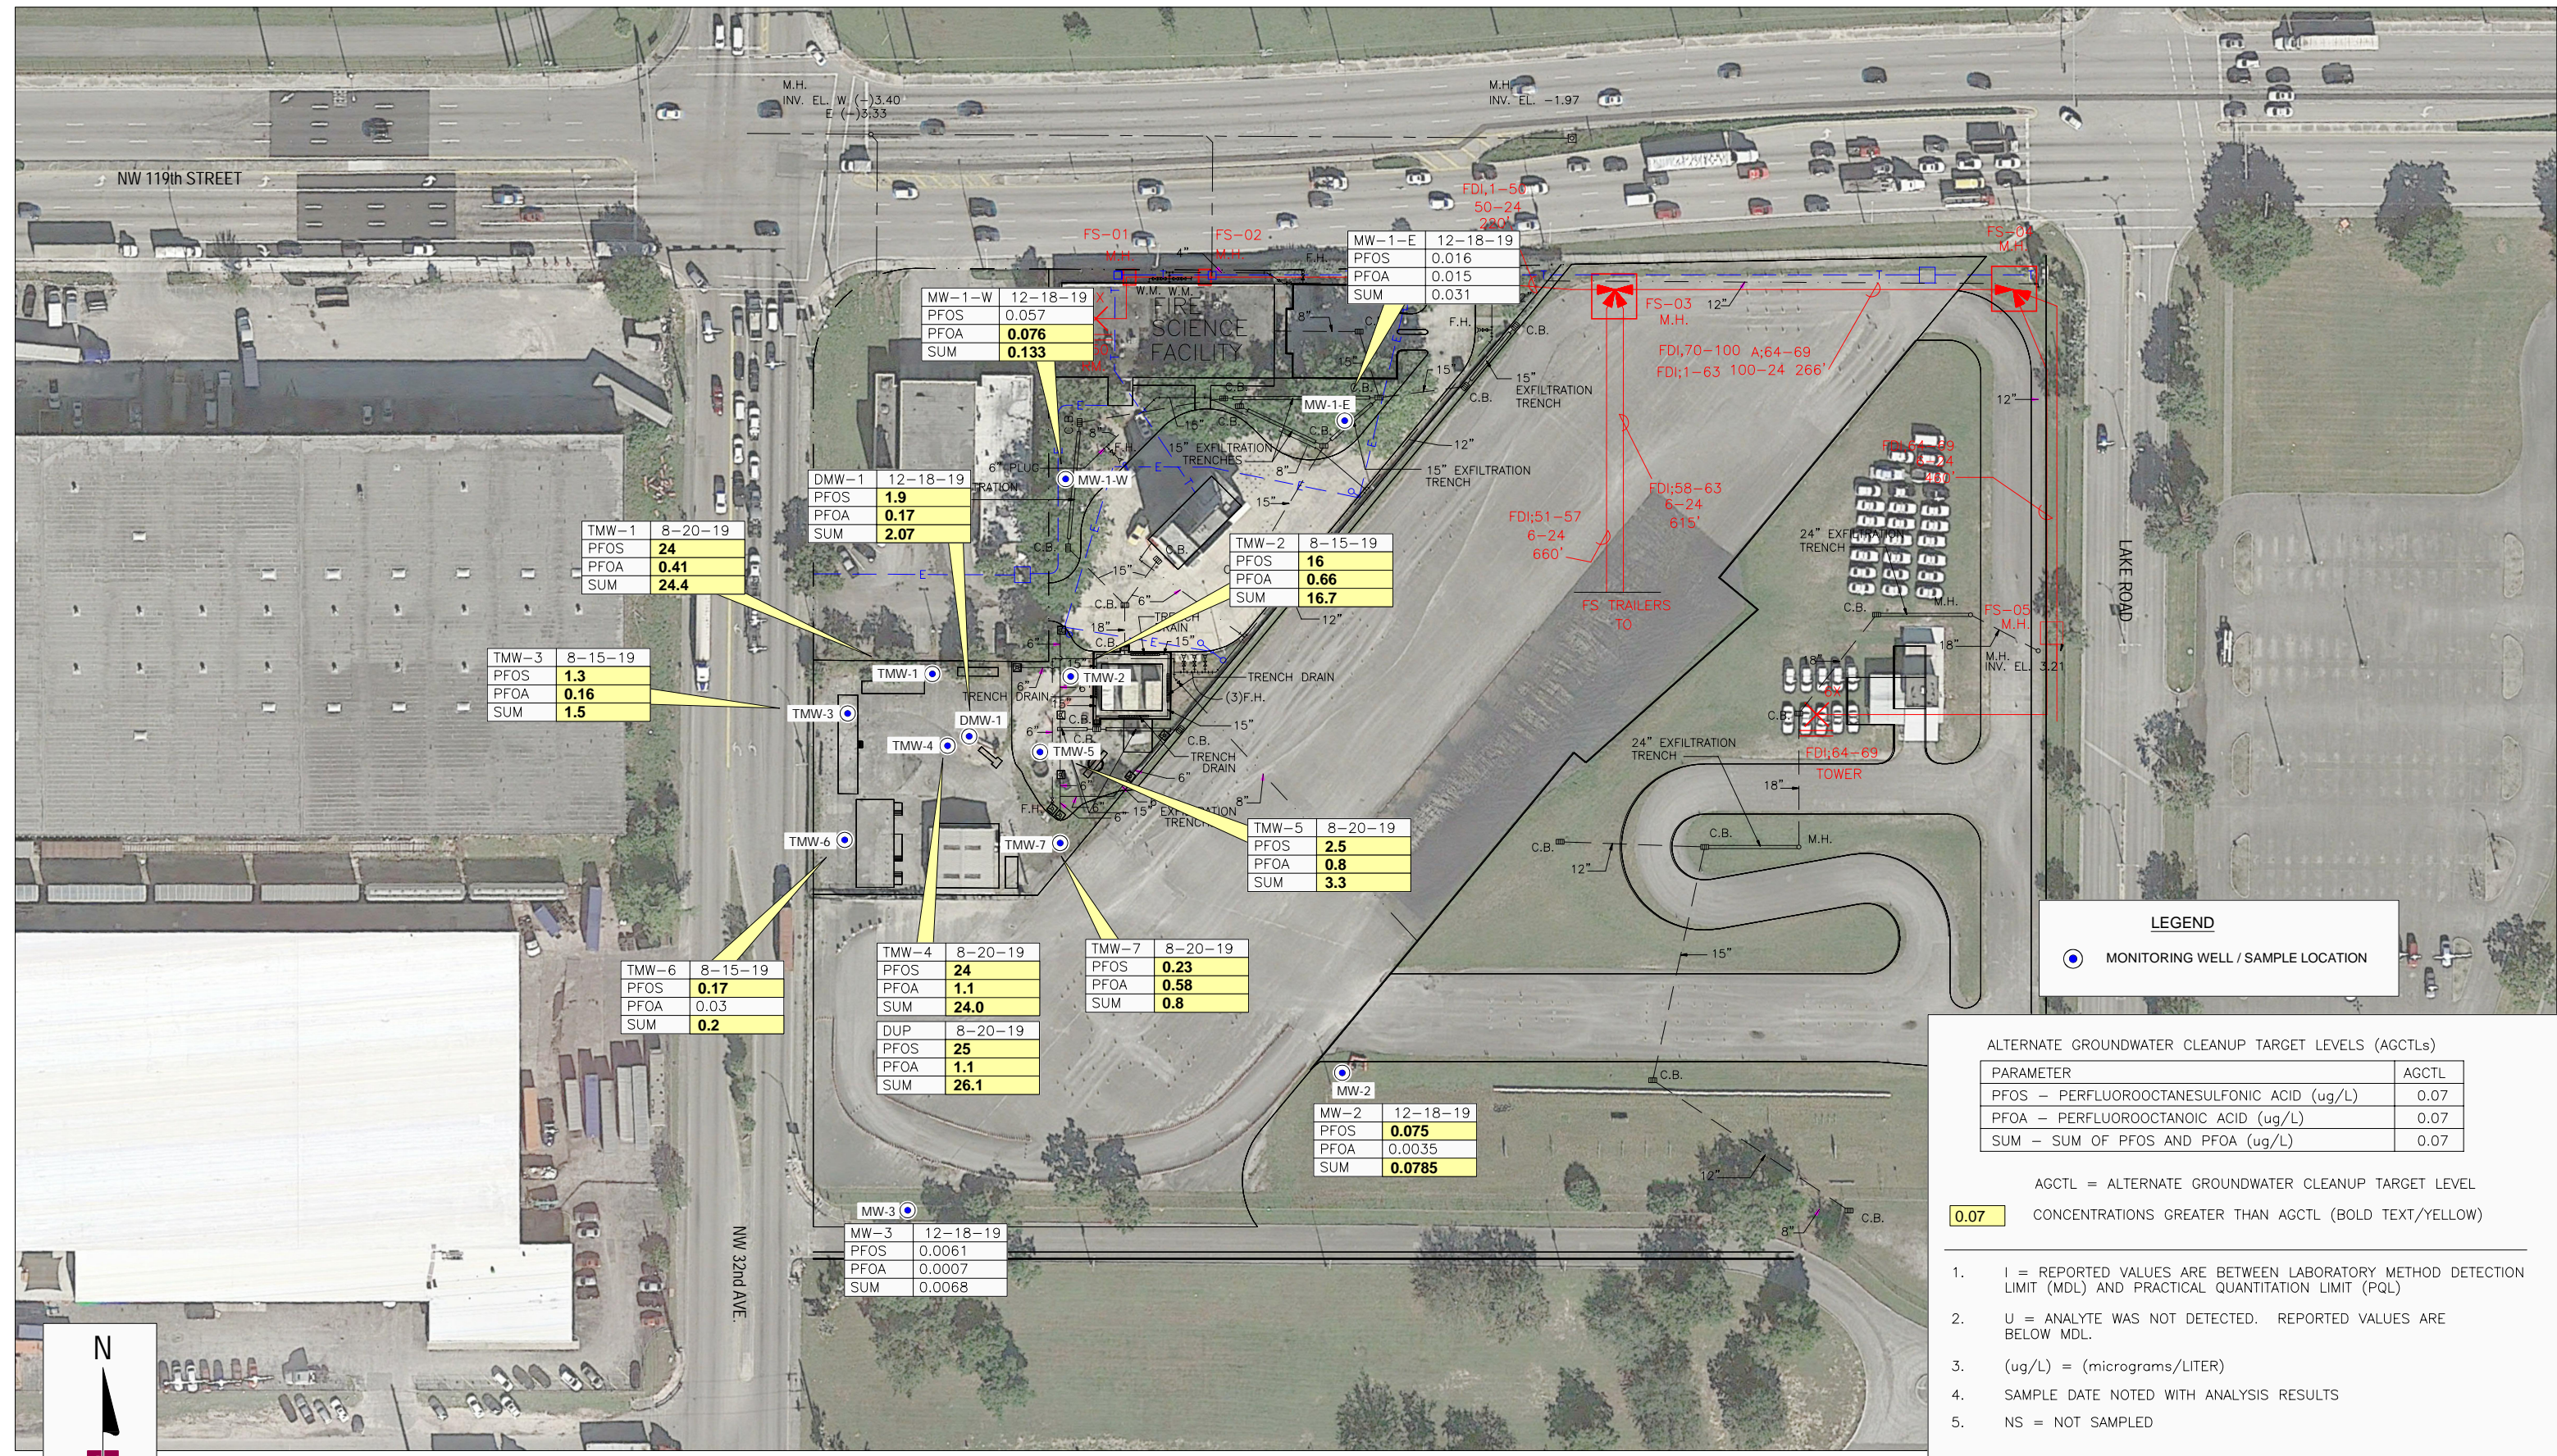

TMW-1	8-20-19
PFOS	<b>24</b>
PFOA	<b>0.41</b>
SUM	<b>24.4</b>

TMW-3	8-15-19
PFOS	<b>1.3</b>
PFOA	<b>0.16</b>
SUM	<b>1.5</b>

TMW-6	8-15-19
PFOS	<b>0.17</b>
PFOA	0.03
SUM	<b>0.2</b>

TMW-4	8-20-19
PFOS	<b>24</b>
PFOA	<b>1.1</b>
SUM	<b>24.0</b>
DUP	8-20-19
PFOS	<b>25</b>
PFOA	<b>1.1</b>
SUM	<b>26.1</b>

TMW-7	8-20-19
PFOS	<b>0.23</b>
PFOA	<b>0.58</b>
SUM	<b>0.8</b>

MW-3	12-18-19
PFOS	0.0061
PFOA	0.0007
SUM	0.0068

MW-1-W	12-18-19
PFOS	0.057
PFOA	<b>0.076</b>
SUM	<b>0.133</b>

DMW-1	12-18-19
PFOS	<b>1.9</b>
PFOA	<b>0.17</b>
SUM	<b>2.07</b>

TMW-2	8-15-19
PFOS	<b>16</b>
PFOA	<b>0.66</b>
SUM	<b>16.7</b>

TMW-5	8-20-19
PFOS	<b>2.5</b>
PFOA	<b>0.8</b>
SUM	<b>3.3</b>



MW-2	12-18-19
PFOS	<b>0.075</b>
PFOA	0.0035
SUM	<b>0.0785</b>

MW-1-E	12-18-19
PFOS	0.016
PFOA	0.015
SUM	0.031

ALTERNATE GROUNDWATER CLEANUP TARGET LEVELS (AGCTLs)	
PARAMETER	AGCTL
PFOS - PERFLUOROCTANESULFONIC ACID (ug/L)	0.07
PFOA - PERFLUOROCTANOIC ACID (ug/L)	0.07
SUM - SUM OF PFOS AND PFOA (ug/L)	0.07

AGCTL = ALTERNATE GROUNDWATER CLEANUP TARGET LEVEL  
**0.07** CONCENTRATIONS GREATER THAN AGCTL (BOLD TEXT/YELLOW)

1. I = REPORTED VALUES ARE BETWEEN LABORATORY METHOD DETECTION LIMIT (MDL) AND PRACTICAL QUANTITATION LIMIT (PQL)
2. U = ANALYTE WAS NOT DETECTED. REPORTED VALUES ARE BELOW MDL.
3. (ug/L) = (micrograms/LITER)
4. SAMPLE DATE NOTED WITH ANALYSIS RESULTS
5. NS = NOT SAMPLED

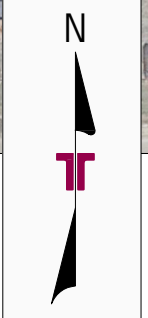

Project Mngr:	LB	Project No:	H8197038
Drawn By:	SW	Scale:	AS SHOWN
Checked By:	LB	File No:	H8197038-1
Approved By:	SH	Date:	1-17-20

**Terracon**  
 Consulting Engineers and Scientists  
 16200 NW 59 AVENUE MIAMI LAKES, FLORIDA 33014  
 PH. (305) 820-1997 FAX. (305) 820-1998

SUMMARY OF GROUNDWATER ANALYTICAL RESULTS  
 SOIL AND GROUNDWATER ASSESSMENT  
 FIRE ACADEMY UTILITIES MDC NORTH  
 NW 119th ST. (SR 924)  
 MIAMI, MIAMI-DADE COUNTY, FLORIDA